

THE CITY OF WALTHAM  
MASSACHUSETTS  
PURCHASING DEPARTMENT

**CEDAR STREET & OAK STREET STORM DRAIN  
AND SURFACE IMPROVEMENTS**

**ADDENDUM NO. 1**

July 27 2014

**CHANGES, CORRECTIONS AND CLARIFICATIONS**

The attention of bidders submitting proposals for the above subject project is called to the following addendum to the specifications. The items set forth herein, whether of omission, addition, substitution or clarification are all to be included in and form a part of the proposal submitted.

THE NUMBER OF THIS ADDENDUM (NO. 1) MUST BE ENTERED IN SECTION 00300-1, PARAGRAPH B OF THE FORM FOR GENERAL BID. PAGE 17 OF THE OVERALL DOCUMENT.

---

**ITEM 1: ADD**

In Section 00020, at the end of the second paragraph, and Section 01010, Part 1 –General, sub section 1.1 A – Description of Work - ADD: ***“Work shall commence at the intersection of Cedar Street and Oak Street and shall continue up on the shorter segment of Oak Street”.***

**ITEM 2. : ANSWERS TO POSED QUESTIONS**

1. Rim grades for Drain Manholes and Catch Basins.

**Answer:** see Drainage Structure Rim Elevations Table Attached

2. Catch Basin and Drain Manhole connections to pipes?

**Answer:** Pipe connections to Catch Basins and Drain Manholes with RCP shall use non shrink grout to fill the core opening around pipe.

3. At pre bid question on the gas mains, what is live and what is abandoned?


**Answer:** National Grid provided the attached map. Further questions; call National Grid 617-719-2248, Richard Alexander

**End of Addendum 1**

**DRAINAGE STRUCTURE RIM ELEVATION TABLE**

<b>Structure</b>	<b>Rim Elev</b>	<b>Structure</b>	<b>Rim Elev</b>
DMH-1	80.7	CB-1	68.1
DMH-2	68.0	CB-2	67.8
DMH-3	67.5	CB-3	67.9
DMH-4	67.7	CB-4	67.7
DMH-5	65.9	CB-5	65.8
DMH-6	63.6	CB-6	65.7
DMH-7	56.5	CB-7	63.7
DMH-8	56.5	CB-8	63.4
DMH-9	56.2	CB-9	56.5
DMH-10	56.1	CB-10	56.4
DMH-11	56.4	CB-11	56.3
DMH-12	57.6	CB-12	56.2
DMH-13	57.8	CB-13	57.3
DMH-14	59.2	CB-14	57.3
DMH-15	57.5	CB-15	57.5
DMH-16	56.3	CB-16	57.6
DMH-17	49.1	CB-17	59.1
DMH-19	40.8	CB-18	59.0
		CB-19	55.9
		CB-20	48.7
		CB-21	40.4
		CB-22	41.0
		CB-23	48.7

- PRESSURE GAUGES ARE REQUIRED AT ALL MAINS FOR ALL TIE-INS. REFER TO GCON-7010 PROCEDURE.
- CHECK ELECTRONIC MAPPING SYSTEM FOR MOST CURRENT MAPPING INFORMATION.

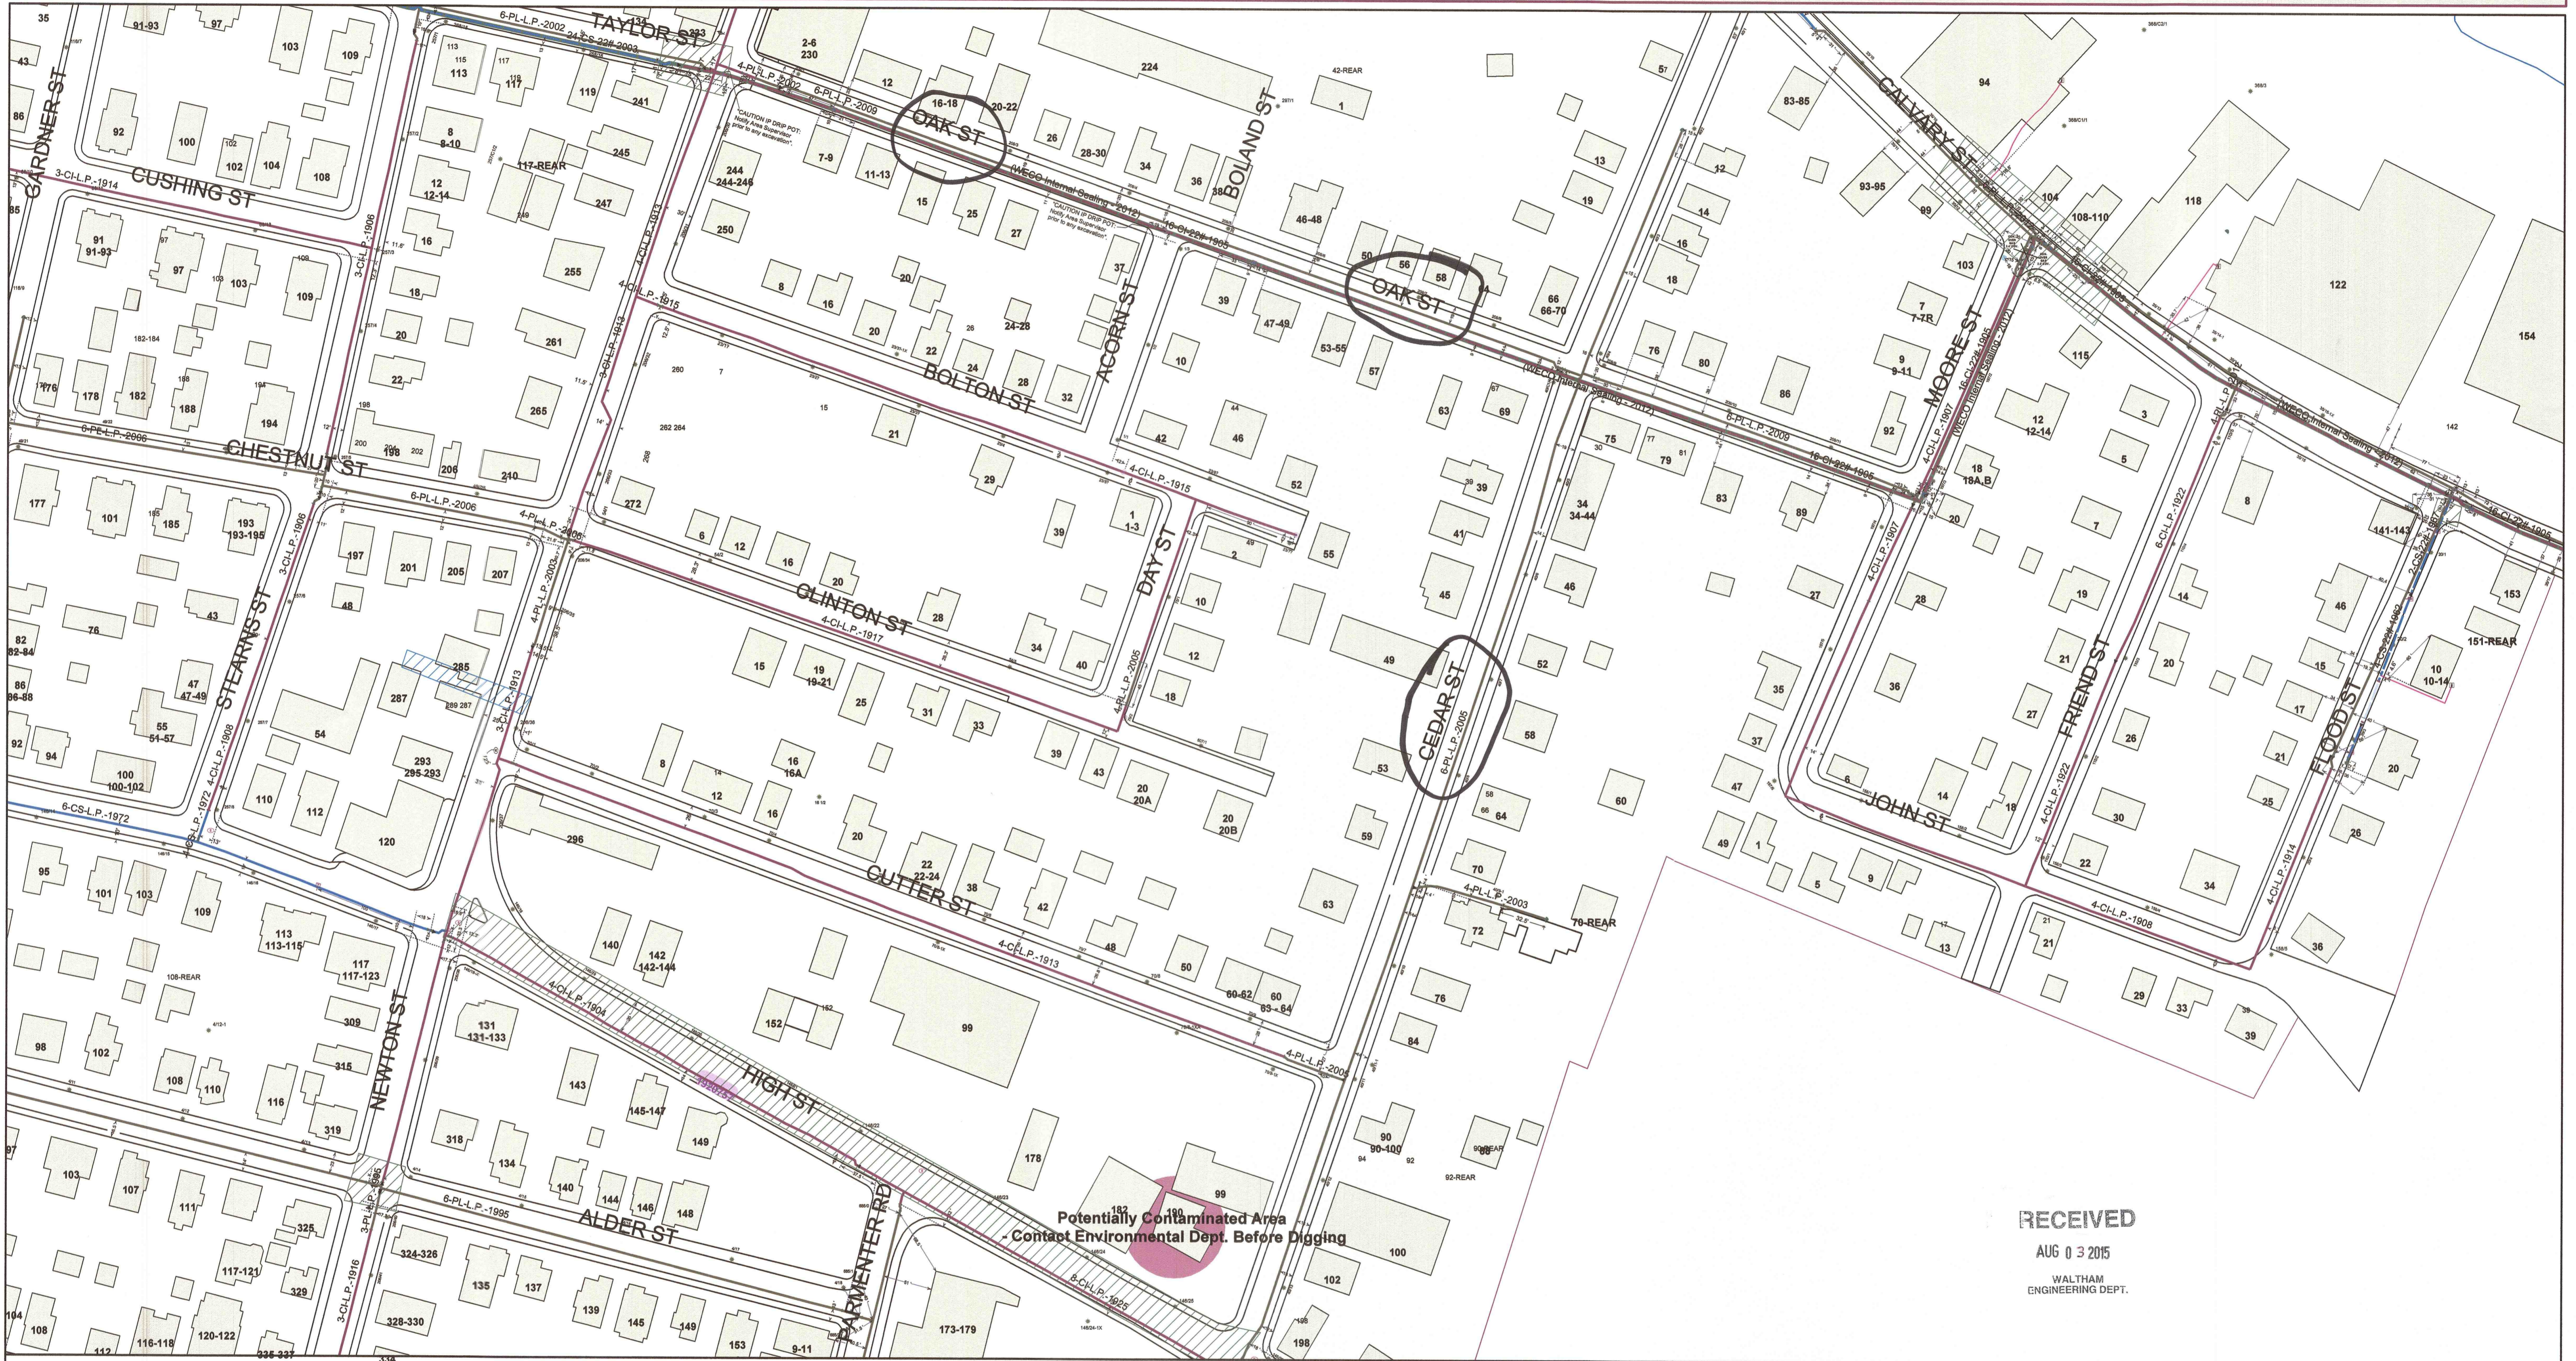


RECEIVED  
AUG 03 2015  
WALTHAM  
ENGINEERING DEPT.

**ENGINEERING DESIGN**

Cedar St & Oak St - unofficial D size

Write Job Description Here

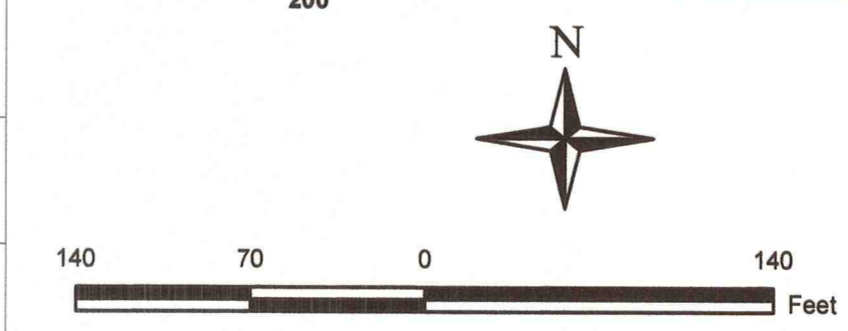

NOTE: The location of surface and underground objects shown are not warranted to be correct.

ENGINEER	XXX	SIZE	0
DATE	mm/dd/yyyy	MATERIAL	XX
LENGTH	0'	PRESSURE	XXXXXX
SECTIONALS	XXXX1234	WORK ORDER #	

ArcFM  
nationalgrid